



IMPORTANT NOTICE - READ CAREFULLY


Installation Instructions

# Yoke Expander Single/Dual Check w/ Tamper Proof Screw Option

Directional Checks Must be Assembled on Outlet Side of Meter


Proprietary Security Screw Sold Separately

Line screw up with external notch on the hex for locking

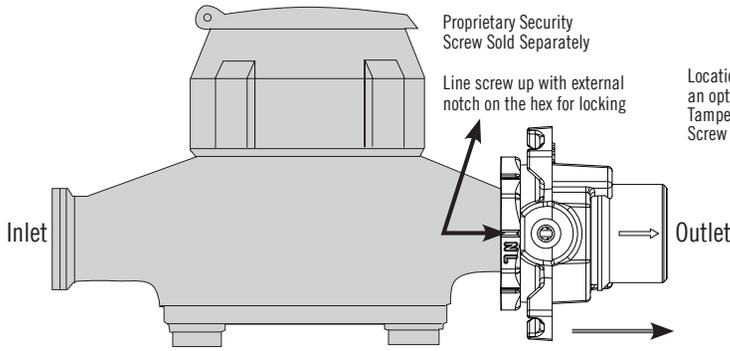

Ensure O-Ring is in Place Before Assembly

Location for an optional Tamper Proof Screw



1" only available with single check, 5/8" & 3/4" only available with dual check

**WARNING:** It is unlawful in CALIFORNIA & VERMONT (effective 1/1/2010); MARYLAND (effective 1/1/2012); LOUISIANA (effective 1/1/2013) and the UNITED STATES OF AMERICA (effective 1/4/2014) to use any product in the installation or repair of any public water system or any plumbing in a facility or system that provides water for human consumption if the wetted surface area of the product has a weighted average lead content greater than 0.25%. This prohibition does not extend to service saddles used in California, Louisiana or under USA Public Law 111-380.



IMPORTANT NOTICE - READ CAREFULLY


Installation Instructions

# Yoke Expander Single/Dual Check w/ Tamper Proof Screw Option

Directional Checks Must be Assembled on Outlet Side of Meter


Proprietary Security Screw Sold Separately

Line screw up with external notch on the hex for locking

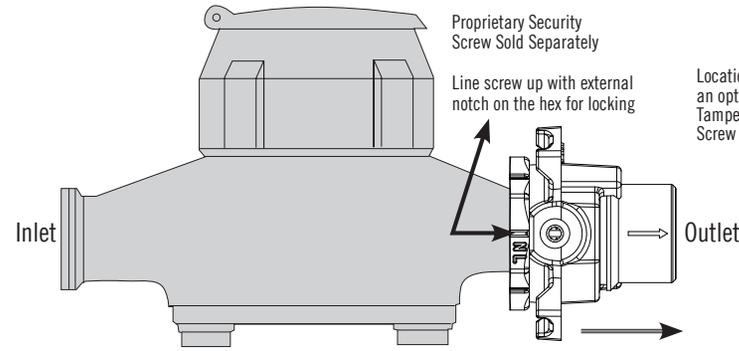

Ensure O-Ring is in Place Before Assembly

Location for an optional Tamper Proof Screw



1" only available with single check, 5/8" & 3/4" only available with dual check

**WARNING:** It is unlawful in CALIFORNIA & VERMONT (effective 1/1/2010); MARYLAND (effective 1/1/2012); LOUISIANA (effective 1/1/2013) and the UNITED STATES OF AMERICA (effective 1/4/2014) to use any product in the installation or repair of any public water system or any plumbing in a facility or system that provides water for human consumption if the wetted surface area of the product has a weighted average lead content greater than 0.25%. This prohibition does not extend to service saddles used in California, Louisiana or under USA Public Law 111-380.



IMPORTANT NOTICE - READ CAREFULLY


Installation Instructions

# Yoke Expander Single/Dual Check w/ Tamper Proof Screw Option

Directional Checks Must be Assembled on Outlet Side of Meter


Proprietary Security Screw Sold Separately

Line screw up with external notch on the hex for locking

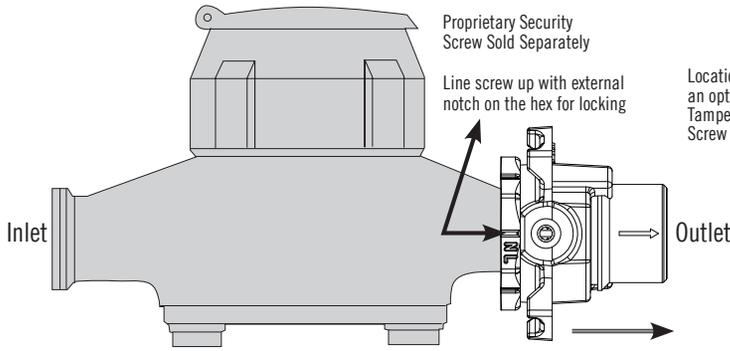

Ensure O-Ring is in Place Before Assembly

Location for an optional Tamper Proof Screw



1" only available with single check, 5/8" & 3/4" only available with dual check

**WARNING:** It is unlawful in CALIFORNIA & VERMONT (effective 1/1/2010); MARYLAND (effective 1/1/2012); LOUISIANA (effective 1/1/2013) and the UNITED STATES OF AMERICA (effective 1/4/2014) to use any product in the installation or repair of any public water system or any plumbing in a facility or system that provides water for human consumption if the wetted surface area of the product has a weighted average lead content greater than 0.25%. This prohibition does not extend to service saddles used in California, Louisiana or under USA Public Law 111-380.



IMPORTANT NOTICE - READ CAREFULLY


Installation Instructions

# Yoke Expander Single/Dual Check w/ Tamper Proof Screw Option

Directional Checks Must be Assembled on Outlet Side of Meter


Proprietary Security Screw Sold Separately

Line screw up with external notch on the hex for locking

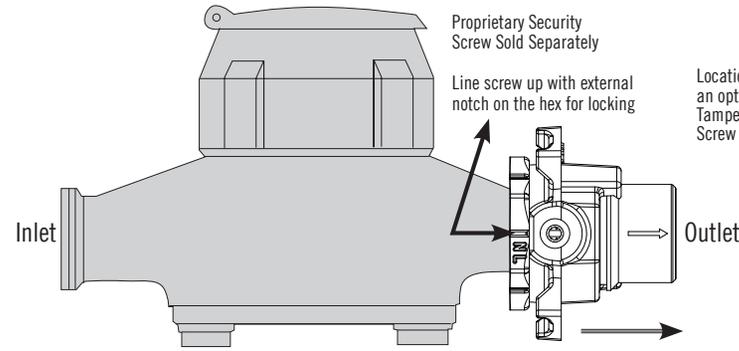

Ensure O-Ring is in Place Before Assembly

Location for an optional Tamper Proof Screw



1" only available with single check, 5/8" & 3/4" only available with dual check

**WARNING:** It is unlawful in CALIFORNIA & VERMONT (effective 1/1/2010); MARYLAND (effective 1/1/2012); LOUISIANA (effective 1/1/2013) and the UNITED STATES OF AMERICA (effective 1/4/2014) to use any product in the installation or repair of any public water system or any plumbing in a facility or system that provides water for human consumption if the wetted surface area of the product has a weighted average lead content greater than 0.25%. This prohibition does not extend to service saddles used in California, Louisiana or under USA Public Law 111-380.



IMPORTANT NOTICE - READ CAREFULLY

Installation Instructions

## Yoke Expander Single/Dual Check w/ Tamper Proof Screw Option

1. Keep expander clean and free from dirt and debris.
2. Protect expander from freezing, which may destroy checks. In the event the expander does freeze, replacement of the expander is recommended.
3. Use a snug fitting smooth jaw wrench on the wrenching flat nearest the tightened end.
4. Protect threads. Avoid loose-fitting wrenches. Do not drop or impact.
5. DO NOT use Vaseline®, plumber's grease, or any other petroleum based product on seals or O-Rings.
6. Maximum operating pressure for checks is 150 PSIG.
7. A pressure relief valve or expansion tank is recommended downstream of device if thermal expansion conditions are possible.
8. USE ONLY ON COLD WATER SERVICES.
9. Locking screw uses left hand threads and proprietary key (sold separately).

3/22

800-292-2737 | sales@aymcdonald.com | aymcdonald.com

3210-582



IMPORTANT NOTICE - READ CAREFULLY

Installation Instructions

## Yoke Expander Single/Dual Check w/ Tamper Proof Screw Option

1. Keep expander clean and free from dirt and debris.
2. Protect expander from freezing, which may destroy checks. In the event the expander does freeze, replacement of the expander is recommended.
3. Use a snug fitting smooth jaw wrench on the wrenching flat nearest the tightened end.
4. Protect threads. Avoid loose-fitting wrenches. Do not drop or impact.
5. DO NOT use Vaseline®, plumber's grease, or any other petroleum based product on seals or O-Rings.
6. Maximum operating pressure for checks is 150 PSIG.
7. A pressure relief valve or expansion tank is recommended downstream of device if thermal expansion conditions are possible.
8. USE ONLY ON COLD WATER SERVICES.
9. Locking screw uses left hand threads and proprietary key (sold separately).

3/22

800-292-2737 | sales@aymcdonald.com | aymcdonald.com

3210-582



IMPORTANT NOTICE - READ CAREFULLY

Installation Instructions

## Yoke Expander Single/Dual Check w/ Tamper Proof Screw Option

1. Keep expander clean and free from dirt and debris.
2. Protect expander from freezing, which may destroy checks. In the event the expander does freeze, replacement of the expander is recommended.
3. Use a snug fitting smooth jaw wrench on the wrenching flat nearest the tightened end.
4. Protect threads. Avoid loose-fitting wrenches. Do not drop or impact.
5. DO NOT use Vaseline®, plumber's grease, or any other petroleum based product on seals or O-Rings.
6. Maximum operating pressure for checks is 150 PSIG.
7. A pressure relief valve or expansion tank is recommended downstream of device if thermal expansion conditions are possible.
8. USE ONLY ON COLD WATER SERVICES.
9. Locking screw uses left hand threads and proprietary key (sold separately).

3/22

800-292-2737 | sales@aymcdonald.com | aymcdonald.com

3210-582



IMPORTANT NOTICE - READ CAREFULLY

Installation Instructions

## Yoke Expander Single/Dual Check w/ Tamper Proof Screw Option

1. Keep expander clean and free from dirt and debris.
2. Protect expander from freezing, which may destroy checks. In the event the expander does freeze, replacement of the expander is recommended.
3. Use a snug fitting smooth jaw wrench on the wrenching flat nearest the tightened end.
4. Protect threads. Avoid loose-fitting wrenches. Do not drop or impact.
5. DO NOT use Vaseline®, plumber's grease, or any other petroleum based product on seals or O-Rings.
6. Maximum operating pressure for checks is 150 PSIG.
7. A pressure relief valve or expansion tank is recommended downstream of device if thermal expansion conditions are possible.
8. USE ONLY ON COLD WATER SERVICES.
9. Locking screw uses left hand threads and proprietary key (sold separately).

3/22

800-292-2737 | sales@aymcdonald.com | aymcdonald.com

3210-582